


A.O. SMITH

TYPICAL WIRING DIAGRAM FOR FOUR BOILER LINEAR-TEMP* INSTALLATION HW-300 THRU 670

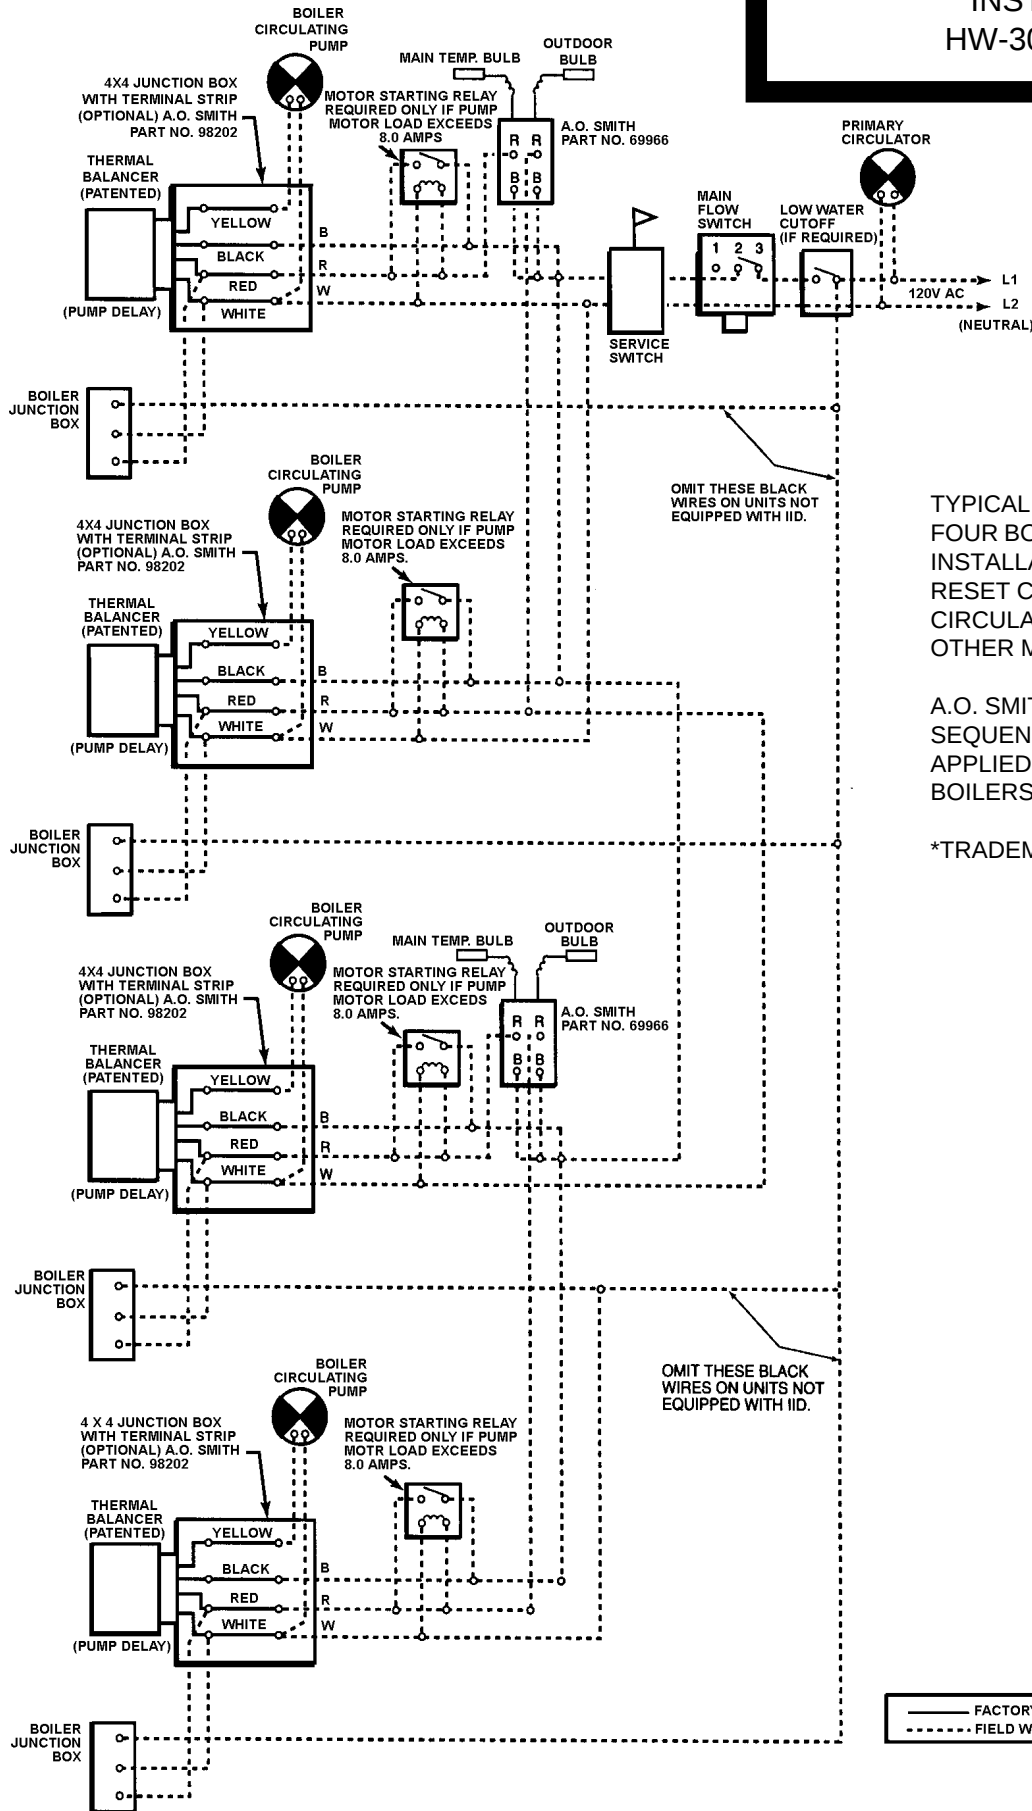

TYPICAL WIRING DIAGRAM FOR A FOUR BOILER LINEAR-TEMP INSTALLATION WITH OUTDOOR RESET CONTROLLING. PRIMARY CIRCULATOR CONTROLLED BY OTHER MEANS.

A.O. SMITH ELECTRONIC SEQUENCING PANEL CAN BE APPLIED TO SEQUENCE 4, 6 OR 8 BOILERS WITH OUTDOOR RESET.

*TRADEMARK, A.O. SMITH CORP.