


*Trademark of A. O. Smith Corp.



TYPICAL WIRING DIAGRAM FOR A ONE BOILER LINEAR-TEMP INSTALLATION WITH OUTDOOR RESET CONTROLLING. PRIMARY CIRCULATOR CONTROLLED BY OTHER MEANS.

A. O. SMITH ELECTRONIC SEQUENCING PANEL CAN BE APPLIED TO SEQUENCE 2-8 BOILERS WITH OUTDOOR RESET.

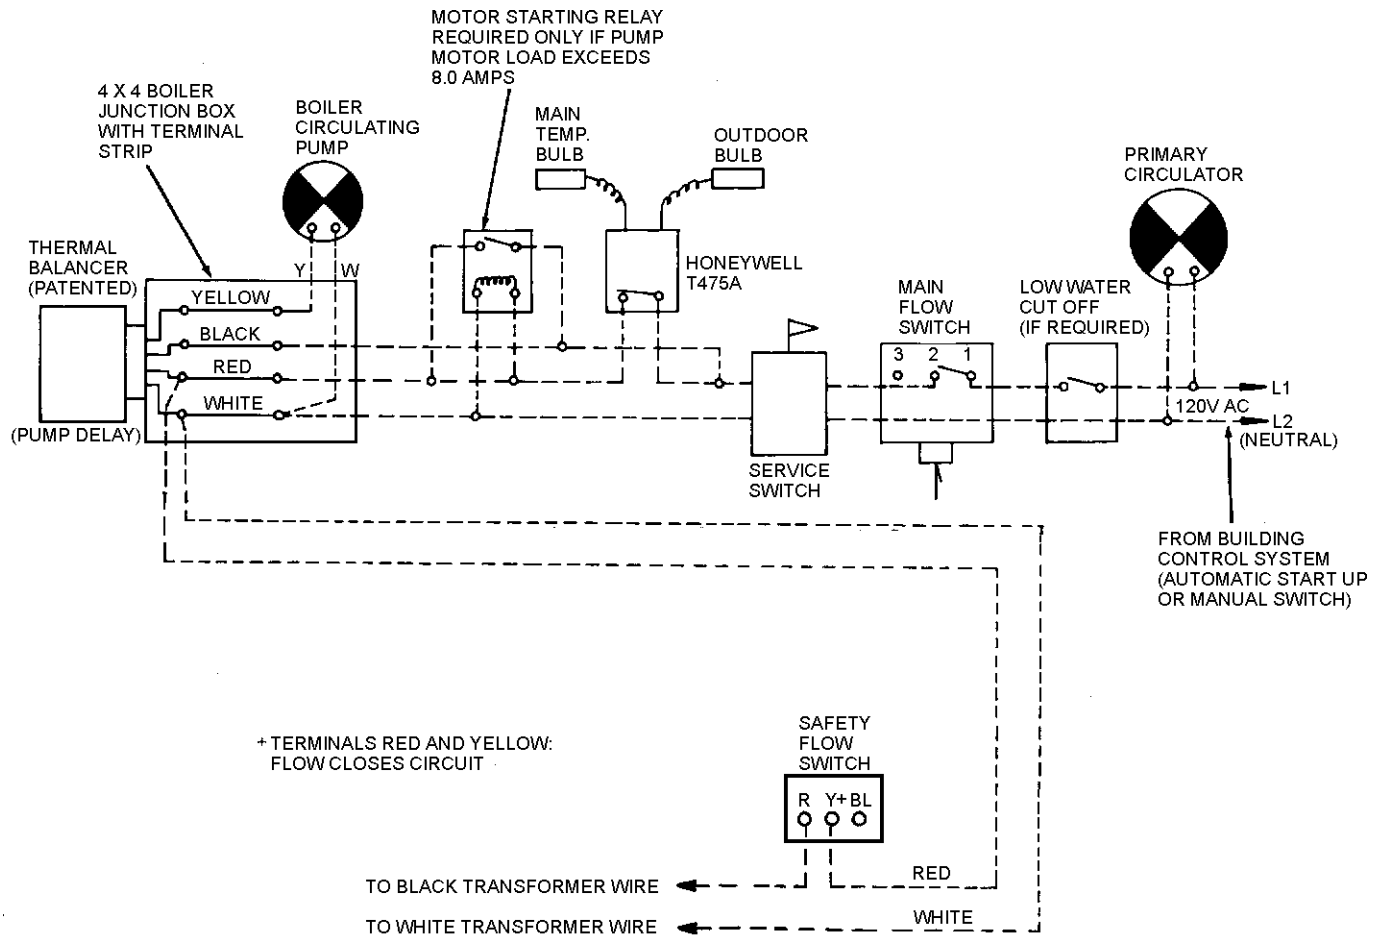