


Submittal Package

Viega ProPress® Stainless

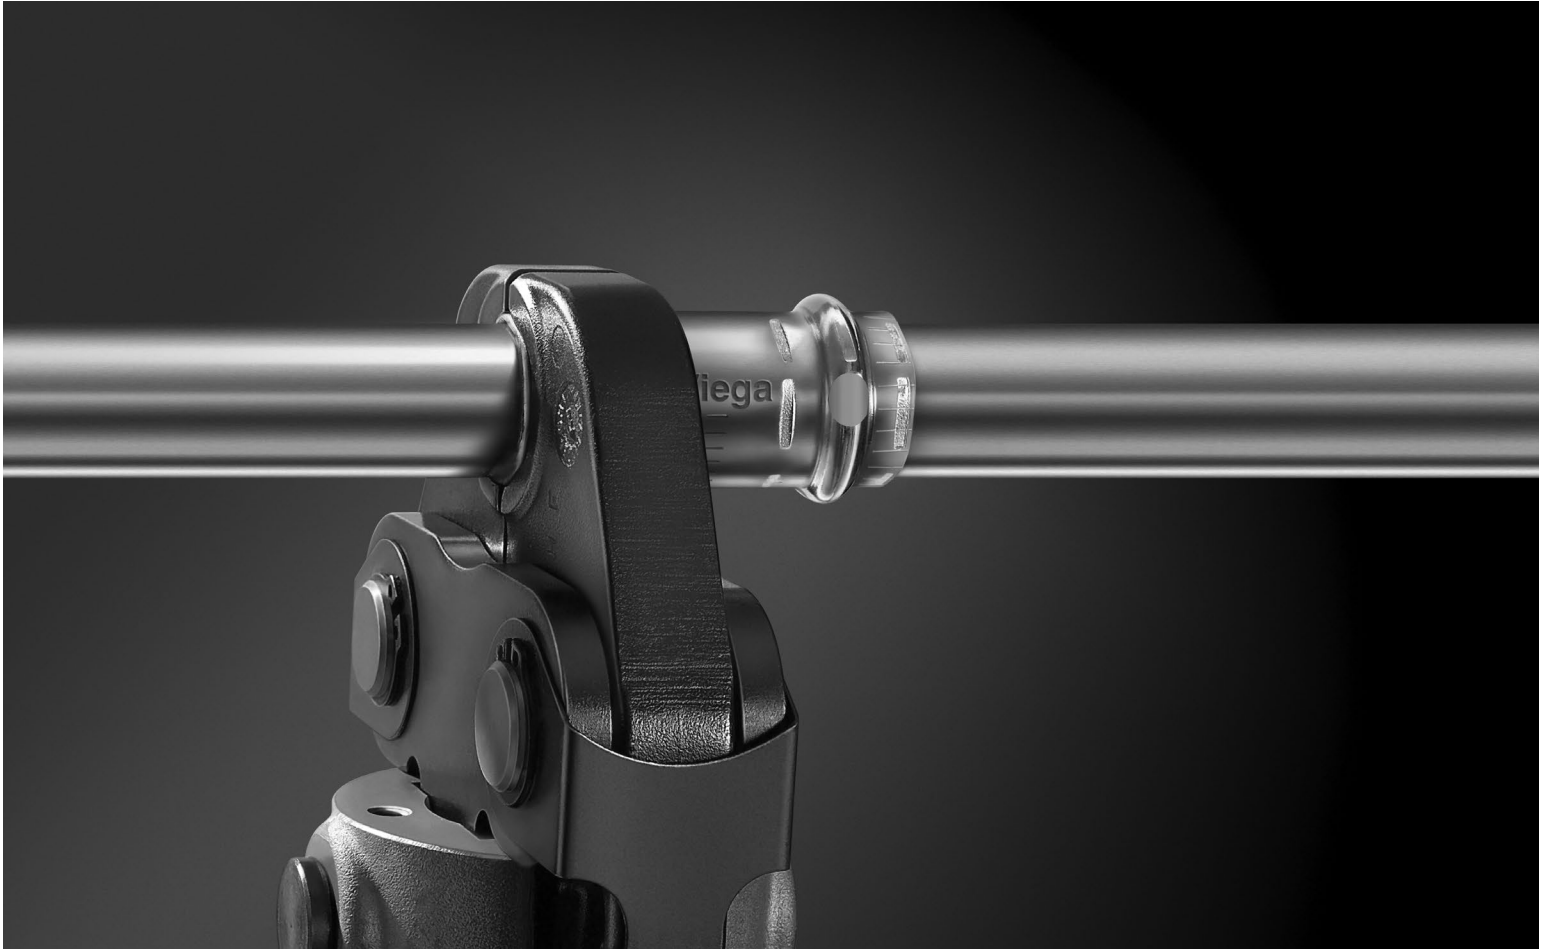

Project _____ Date _____

Engineer _____ Contractor _____

Submitted by _____

Approved by _____ Date _____ Approved by _____ Date _____

Table of Contents

Chilled Water
Hydronic Heating
Fire Protection
Low-Pressure Steam
Compressed Air
Industrial Gases
Vacuum

1	System Data Sheet	3
	ProPress 316 Fittings	3
2	Tech Data Sheet	4
	ProPress 316 ECO Tubing	4
	ProPress Stainless Tubing	5
	ProPress 316 Ball Valve	6
3	Product Instructions	7
	ProPress Stainless ½" to 4" Fittings	7
4	Engineering Specifications	9
	ProPress Stainless	9
5	Dimensional Documents	13
	ProPress Stainless Fittings	13
6	Limited Warranty – Viega Metal Systems	24



This document is subject to updates. For the most current Viega technical literature, please visit www.viega.us.



Viega products are designed to be installed by licensed and trained plumbing and mechanical professionals who are familiar with Viega products and their installation. **Installation by non-professionals may void Viega LLC's warranty.**

1 System Data Sheet

ProPress 316 Fittings



ProPress 316 is a stainless steel system designed to be used with Viega 316 stainless steel tubing to form a complete press system that is ideal for process water and durable enough to handle industrial applications or environments. ProPress

316 fittings feature the same EPDM sealing element found in ProPress copper fittings and provide the same permanent leak-free connections in dimensions from ½" to 4".

ProPress 316 fittings are offered in configurations that include elbows, couplings, reducers, tees, reducing tees, threaded adapters, unions, caps, and flanges. ProPress 316 fittings in 2½" to 4" have a 420 stainless steel grip ring and a PBT separator ring in addition to the EPDM sealing element.

Operating Parameters

- Operating pressure: 200 psi maximum
- Test pressure: 600 psi maximum
- Operating temperature: 0°F-250°F

Listings and Certifications

- ABS
- IAPMO/ANSI/CAN Z1117
- ICC-ES LC1002
- NSF®-61
- NSF®-372

International Listings and Certifications

- BV: Bureau Veritas
- DNV GL: Det Norske Veritas Germanischer
- LR: Lloyd's Register
- NKK: Nippon Kaija Kyokai



Listings, certifications, and approvals are shown for reference only and may not cover every item in the product line. They are subject to change, with the most current official listings located on the appropriate agency's portal.

Compliant With

- ASME B31, B31.1, B31.3, B31.9
- ASTM A312
- ASTM A403
- ASTM A778
- IAPMO Uniform Mechanical Code (UMC)
- ICC International Mechanical Code (IMC)

Approved Applications

- Hot and cold potable water
- Hydronic heating (with glycol)
- Chilled water
- Low-pressure steam (15 psi max with FKM sealing element)
- Residential steam (5 psi max)
- Isopropyl alcohol
- Latex paint
- Phosphoric acid
- Compressed air
- Non-medical gases
- Vacuum (29.2" Hg maximum 68°F)

ProPress 316 systems are approved for underground use. When installed underground, ProPress 316 fittings should have proper corrosion protection in accordance with local and national codes.


For more specific information on applications for ProPress 316, contact Viega Technical Services at 1-800-976-9819.

Smart Connect® Technology

ProPress 316 fittings are manufactured with Viega's unique Smart Connect technology. A design of the fitting, Viega Smart Connect technology allows identification of an unpressed fitting during pressure testing.

2 Tech Data Sheet

ProPress 316 ECO Tubing



Nominal Tube Size (in)	Part No.
1/2	82150
3/4	82155
1	82160
1 1/4	82165
1 1/2	82170
2	82175
2 1/2	82180
3	82185
4	82190

Tube Dimensional Data

Nominal Tube Size (in)	Outside Diameter (OD)		Inside Diameter (ID)		Wall Thickness		Weight	
	(in)	(mm)	(in)	(mm)	(in)	(mm)	(lb./ft.)	(per 20 ft. length)
1/2	0.63	15.88	0.55	13.88	0.04	1.00	0.25	5.00
3/4	0.88	22.23	0.78	19.83	0.05	1.20	0.43	8.60
1	1.13	28.58	1.03	26.18	0.05	1.20	0.55	11.00
1 1/4	1.38	35.00	1.26	32.00	0.06	1.50	0.85	17.00
1 1/2	1.63	41.28	1.51	38.28	0.06	1.50	1.01	20.20
2	2.13	54.00	2.01	51.00	0.06	1.50	1.33	26.60
2 1/2	2.63	66.68	2.47	62.68	0.08	2.00	2.18	43.60
3	3.13	79.38	2.97	75.38	0.08	2.00	2.60	52.00
4	4.13	104.78	3.97	100.78	0.08	2.00	3.46	69.20

Zero Lead identifies Viega products meeting the lead free requirements of NSF/ANSI/CAN 61 through testing under NSF/ANSI/CAN 372 (0.25% or less maximum weighted average lead content).

Pipe dimensionally (OD) conforms to ASME B88.


Conforms to ASTM A554 and ASTM A778.

Pipe wall conforms to the requirements of schedule 5S steel pipe per ASME B36.10M.

Wall thickness is the minimum allowable.

Tech Data Sheet

ProPress Stainless Tubing



Nominal Tube Size (in)	Part No. ASTM A312 316
1/2	82000
3/4	82005
1	82010
1 1/4	82015
1 1/2	82020
2	82025
2 1/2	82042
3	82050
4	82055

Tube Dimensional Data

Nominal Tube Size (in)	Outside Diameter (OD)		Inside Diameter (ID)		Wall Thickness		Weight	
	(in)	(mm)	(in)	(mm)	(in)	(mm)	(lb./ft.)	(per 20 ft. length)
1/2	0.63	15.88	0.50	12.78	0.06	1.55	0.41	8.20
3/4	0.88	22.23	0.75	19.13	0.06	1.55	0.59	11.80
1	1.13	28.58	1.00	25.48	0.06	1.55	0.77	15.40
1 1/4	1.38	35.00	1.26	31.90	0.06	1.55	0.95	19.00
1 1/2	1.63	41.28	1.50	38.18	0.06	1.55	1.13	22.60
2	2.13	54.00	2.00	50.90	0.06	1.55	1.50	30.00
2 1/2	2.63	66.68	2.47	62.68	0.08	2.00	2.18	43.60
3	3.13	79.38	2.97	75.38	0.08	2.00	2.60	52.00
4	4.13	104.78	3.97	100.78	0.08	2.00	3.46	69.20

Tube dimensionally (OD) conforms ASME B88.

ASTM A312 denotes welded annealed stainless steel pipe.

Pipe wall conforms to the requirements of schedule 5S steel pipe per ASME B36.10M.

Wall thickness is the minimum allowable.

Tech Data Sheet

ProPress 316 Ball Valve



Description

The ProPress 316 two-piece ball valve can be used in a variety of commercial and industrial applications. The EPDM sealing elements make it the

perfect choice for potable water systems while the durable 316 stainless steel allows it to stand up to some of the harshest environments found in power plants, refineries, utilities, and mills. The double EPDM stem seals prevent leaks without the need for constant adjustment. The 316 stainless steel ball valves are available in sizes ranging from ½" to 2" and are equipped with Viega's unique Smart Connect® technology for easy identification of unpressed connections during pressure testing.

Features

- ProPress press ends
- 316 stainless steel ball and stem
- Full-port, two-piece design
- Blowout-proof stainless steel stem
- Reinforced PTFE seats
- Lockable metal handle

Ratings


- 250 CWP
- Temperature range: 0°F-250°F
- Max. operating pressure: 200 psi

Approvals

- Conforms to MSS SP-110
- NSF®-61 Annex G
- NSF®-372

Component	Material
Body	316 stainless steel
Ball	316 stainless steel
Seat	Reinforced PTFE
Stem	316 stainless steel
Stem seals	EPDM
Nut	Zinc-plated steel
Handle	Zinc-plated steel
Handle cover	Polyvinyl
Sealing element	EPDM

Viega ProPress 316 Ball Valve Model 4070

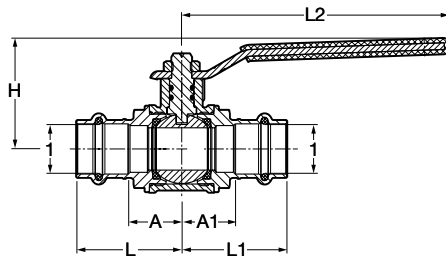


Part No.	Size (in)	A (in)	A1 (in)	L (in)	L1 (in)	L2 (in)	H (in)
1							
81080	½	0.89	1.17	1.64	1.92	5.55	2.44
81085	¾	1.06	1.36	1.97	2.26	5.55	2.52
81090	1	1.18	1.57	2.09	2.48	5.55	2.68
81095	1¼	1.45	1.72	2.48	2.75	6.10	3.09
81100	1½	1.83	1.81	3.26	3.24	6.10	3.34
81105	2	1.97	2.18	3.54	3.78	6.10	3.66

3 Product Instructions

ProPress Stainless 1/2" to 4" Fittings

For use only with Viega stainless steel tubing.

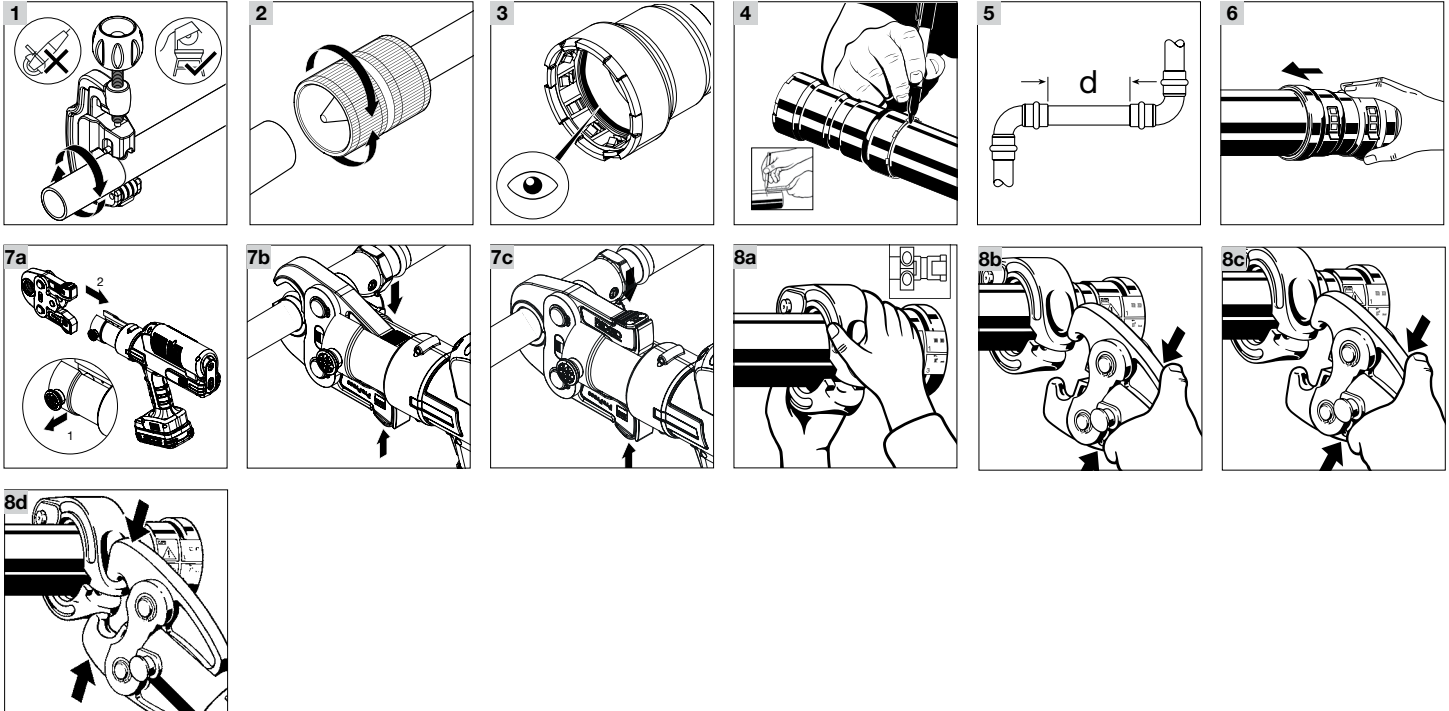

DANGER!
Read and understand all instructions for installing Viega ProPress fittings. Failure to follow all instructions may result in extensive property damage, serious injury, or death.

- 1 Cut the tube square. Do not deform the tube when cutting.
- 2 Remove burr from inside and outside of the tube and prep to proper insertion depth using a preparation tool or fine-grit sandpaper.
- 3 Fittings contain a sealing element and may contain a separator ring or grip ring. Check that all components are present, clean, and undamaged. Do not use oils or lubricants.



For applications requiring different sealing elements, remove the factory-installed sealing element and replace with the applicable sealing element. See [Changing Sealing Elements Product Instructions](#).

- 4 Mark proper insertion depth as indicated by the following ProPress Minimum Insertion Depth chart. Improper insertion depth may result in an improper seal. It is recommended that the depth marking be visible on the completed assembly.

ProPress Minimum Insertion Depth		
Tube size (in)	d (in)	d (mm)
1/2	3/4	19
3/4	7/8	23
1	7/8	23
1 1/4	1	26
1 1/2	1 1/16	37
2	1 9/16	40
2 1/2	1 11/16	43
3	1 15/16	50
4	2 3/8	60

- 5 Refer to the following chart for the minimum distance between fittings to ensure a correct press. Failure to provide this distance may result in an improper seal.

ProPress Minimum Distance (d)

Tube size (in)	d (in)	d (mm)
1/2	0	0
3/4	0	0
1	0	0
1 1/4	7/16	10
1 1/2	5/8	15
2	3/4	20
2 1/2	5/8	15
3	5/8	15
4	5/8	15

- 6 While turning slightly, slide fitting onto the tube to the marked depth. End of tube must contact stop. Once the assembly is completed, it is recommended that the depth marking still be visible.



Warning!
Keep extremities and foreign objects away from press tool during pressing operation to prevent injury or incomplete press.

Pressing ½" to 2" Fittings

- 7a** Insert appropriate Viega ProPress jaw (2) into the press tool and push in, holding pin (1) until it locks in place.
- 7b** Open the jaw and place at right angles on the fitting. Visually check insertion depth using mark on tubing.
- 7c** Hold trigger on press tool until press jaws have fully engaged the fitting. Jaws will automatically release after a full press is made. After pressing, open the jaw and remove the press tool.

Pressing 2½" to 4" Fittings

- 8a** ProPress 2½" to 4" connections must be performed with compatible rings. Do not mix actuators and rings from different manufacturers. Do not use rings intended for 2½" to 4" bronze fittings. Use of incompatible rings will result in an improper connection.
- 8b** Open XL-C ring and place at right angles on the fitting. XL-C ring must be engaged on the fitting bead. Check insertion depth.
- 8c** With V2 actuator inserted into the tool, open the V2 actuator and connect it to the XL-C ring.
- 8d** Hold the trigger until the V2 actuator has fully engaged the XL-C ring. Keep extremities and foreign objects away from XL-C ring and V2 actuator during pressing operation to prevent injury or incomplete press. Upon completion of the press, release the V2 actuator from XL-C ring. Remove the XL-C ring from the fitting.

Pressure testing with Smart Connect®

Technology

Unpressed connections are located by pressurizing the system with air or water. When testing with water the proper pressure range is 15 psi to 85 psi. When testing with compressed air the proper pressure range is ½ psi to 45 psi maximum. If testing with compressed air, use an approved leak-detect solution. Following a successful pressure test, the system may be pressure tested up to 200 psi with air or up to 600 psi with water.



Testing for unpressed connections using Smart Connect is not a replacement for pressure testing requirements of local codes and standards.



CAUTION!

It is the responsibility of designers of piping systems to verify the suitability of type 304 and 316 stainless steel pipe for use with the intended fluid media. The fluid's chemical composition, pH level, operation temperature, chloride level, oxygen level, and flow rate and their effect on AISI type 304 or 316 stainless steel must be evaluated by the material specifier to confirm system life will be adequate for the intended service. Failure to do so may cause serious personal injury or property damage. Contact Viega Technical Services for questions and approvals.

4 Engineering Specifications

ProPress Stainless

Part 1: General

1.1 Summary

Stainless steel tube and fitting system using cold press connection technology. The system is assembled when the tube is fully inserted into the fitting, then pressed on both sides of the fitting seal, creating a mechanical joint.

1.2 Definitions

ASME: American Society of Mechanical Engineers
 ASTM: American Society for Testing and Materials
 AWWA: American Water Works Association
 EPDM: Ethylene Propylene Diene Monomer
 FKM: Fluoroelastomer
 IAPMO: International Association of Plumbing & Mechanical Officials
 ICC: International Code Council
 MSS: Manufacturers Standardization Society
 NSF: National Sanitation Foundation

1.3 References

ASME A13.1: Scheme for the Identification of Piping Systems
 ASME B1.20 Pipe Threads, General Purpose (Inch)
 ASME B31.1 Power Piping
 ASME B31.3 Process Piping
 ASME B31.9 Building Services Piping
 ASTM 1029: Standard Practice for Press-Connect Joints with Seamless Copper and Copper Alloy Tube and Press Fittings
 ASTM A312 Standard Specification for Seamless, Welded, and Heavily Cold Worked Austenitic Stainless Steel Pipes
 ASTM A554 Standard Specification For Welded Stainless Steel Mechanical Tubing
 ASTM A778 Unannealed Austenitic Stainless Steel Tubular
 AWWA C651 Standard for Disinfecting Water Mains
 IAPMO: Uniform Mechanical Code (UMC)
 IAPMO: Uniform Plumbing Code (UPC)
 ICC: International Plumbing Code (IPC)
 ICC: International Mechanical Code (IMC)
 MSS-SP-58 Pipe Hangers and Supports - Materials, Design and Manufacture
 NSF®-61-372 Drinking Water System Components-Health Effects

1.4 Quality Assurance

- A. Installer shall be a qualified installer, licensed within the jurisdiction, and familiar with the installation of stainless steel tube.
- B. The installation of stainless steel tube for hot and cold water distribution systems shall conform to the requirements of the ICC International Plumbing Code or IAPMO Uniform Plumbing Code. The installation of stainless steel tube in hydronic systems shall conform to the requirements of the ICC International Mechanical Code or the IAPMO Uniform Mechanical Code.

1.5 Delivery, Storage, and Handling

- A. Stainless steel tube shall be shipped to the job site on truck or in such a manner to protect the tube. The tube and fittings shall not be roughly handled during shipment. The tube and fittings shall be unloaded with reasonable care.
- B. Protect the stored tube from moisture and dirt. Elevate above grade. When stored inside, do not exceed the structural capacity of the floor.
- C. Protect fittings and piping from moisture and dirt.

1.6 Project Conditions

Verify length of tube required by field measurements.

1.7 Warranty

- A. The tube and fittings manufacturer shall warrant that the tube and fittings are free from defects and conform to the designated standard. The warranty shall only be applicable to tube and fittings installed in accordance with the manufacturer's installation instructions.
- B. The manufacturer of the tube and fittings shall not be responsible for the improper use, handling, or installation of the product.

Part 2: Products

2.1 Manufactures

Viega LLC
585 Interlocken Blvd.
Broomfield CO, 80021
Phone: (800) 976-9819
www.viega.us

2.2 Material

- A. Tube standard: stainless steel tube shall conform to ASTM A312 or ASTM A554.
- B. Fitting standard: stainless steel fittings shall conform to the material requirements of ASTM A312 or ASTM A554.
- C. Press fitting: stainless steel press fittings shall conform to the material and sizing requirements of ASME A312 or ASTM A554. O-rings for stainless steel press fittings shall be EPDM or FKM, depending on the application.
- D. Threaded fittings: tube threads shall conform to ASME B1.20.1.
- E. Hanger standard: hangers and supports shall conform to MSS-SP-58.

2.3 Source Quality Control

All tube, fittings, and joining materials in contact with drinking water shall be listed by a third party agency to NSF 61.

Part 3: Execution

3.1 Examination

The installing contractor shall examine the stainless steel tube and fittings for defects and cracks. There shall be no defects of the tube or fittings. Any damaged tube or fittings shall be rejected.

3.2 Preparation

- A. Stainless steel tube shall be cut with a wheeled tube cutter or approved stainless steel tube cutting tool. The tube shall be cut square to permit proper joining with the fittings.
- B. Remove scale, slag, dirt, and debris from inside and outside of tube and fittings before assembly. The tube end shall be wiped clean and dry. The burrs on the tube shall be reamed with a deburring or reaming tool.

3.3 Installation General Locations

Plans indicate general location and arrangement of piping systems. Identified locations and arrangements are used to size tube and calculate friction loss, expansion, pump sizing, and other design considerations. Install piping as indicated, except where deviations to layout are approved on coordination drawings.

3.4 Installation

- A. Pressure rating: install components having a pressure rating equal to or greater than the system operating pressure.
- B. Install piping free of sags, bends, and kinks.
- C. Change in direction: install fittings for changes in direction and branch connections.
- D. Press connections: stainless steel press fittings shall be made in accordance with the manufacturer's installation instructions. The tube shall be fully inserted into the fitting and the tube marked at the shoulder of the fitting. The fitting alignment shall be checked against the mark on the tube to assure the tube is fully engaged (inserted) in

the fitting. The joints shall be pressed using the tool approved by the manufacturer.

- E. Threaded joints: threaded joints shall have pipe joint compound or teflon tape applied to the male threads only. Tighten joint with a wrench and backup wrench as required.
- F. Tube protection: provide protection against abrasion where stainless steel tube is in contact with other building members by wrapping with an approved tape, pipe insulation, or otherwise suitable method of isolation.
- G. Penetration protection: provide allowance for thermal expansion and contraction of stainless steel tube passing through a wall, floor, ceiling, or partition by wrapping with an approved tape or pipe insulation or by installing through an appropriately sized sleeve. Penetrations for fire resistant rated assemblies shall maintain the rating of the assembly.
- H. Backfill material: backfill material shall not include any ashes, cinders, refuse, stones, boulders, or other materials which can damage or break the tube or promote corrosive action in any trench or excavation in which tube is installed.
- I. Horizontal support: install hangers for horizontal piping in accordance with local code or the following maximum spacing and minimum rod sizes.

Nominal Tube Size (in)	Stainless Steel Tube Max. Span (ft)	Min. Rod Diameter (in)
Up to ¾	10	¾
1	10	¾
1¼	10	¾
1½	10	¾
2	10	¾
2½	11	½
3	12	½
4	14	⅝

All systems must be installed per local codes and/or standards and requirements. Consult the Viega technical support department before installing the system in other applications or applications with temperatures and/or pressures outside the stated ratings. Refer to Viega's Application Guide for more information.

- J. Vertical support: vertical stainless steel tube shall be supported at each floor or at 10 foot intervals.
- K. Galvanic corrosion: hangers and supports shall be either stainless steel or vinyl coated to prevent galvanic corrosion between the tube and the supporting member.
- L. Restraint: in seismic areas, stainless steel tube shall be installed to withstand all seismic forces.
- M. Identification: stainless steel tube systems shall be identified in accordance with the requirements of ASME A13.1.

3.5 Field Quality Control

- A. Viega ProPress Stainless includes Smart Connect® technology, a quick and easy way of identifying unpressed connections during the pressure testing process. This indentation is removed during the pressing process, creating a leak-free, permanent connection. Smart Connect technology provides identification of connections which have not been pressed prior to putting the system in to operation. Smart Connect technology may be pressure tested with air or water.
 - When testing with air, the pressure range is ½ psi to 45 psi maximum.
 - When testing with water, the pressure range is 15 psi to 85 psi maximum.
- B. The Smart Connect technology pressure test is not a substitute for local code required pressure testing of the piping system. Carry out the final piping system pressure test in accordance with local codes.

3.6 Cleaning (Potable Water Systems)


- A. Disinfection: the stainless steel hot and cold water distribution system shall be disinfected prior to being placed in service. The system shall be disinfected in accordance with AWWA C651 or the following requirements:
 1. The piping system shall be flushed with potable water until discolored water does not appear at any of the outlets.

2. The system shall be filled with a water chlorine solution containing between 50 and 200 parts per million of chlorine. The system shall be valved in the closed position and allowed to stand for 24 hours.
3. Following the standing time, the system shall be flushed with water until the chlorine is purged from the system.

5 Dimensional Documents


ProPress Stainless Fittings

ProPress Stainless Tubing – Model 4003

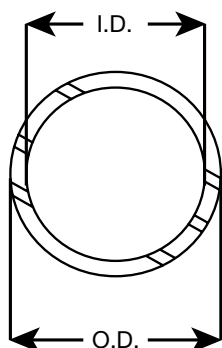


Part No.	Size (in)	O.D. (in)	I.D. (in)	Wall Thickness (in)	Length (ft)
316					
82000	½	0.63	0.50	0.06	20
82005	¾	0.88	0.75	0.06	20
82010	1	1.13	1.00	0.06	20
82015	1¼	1.38	1.26	0.06	20
82020	1½	1.63	1.50	0.06	20
82025	2	2.13	2.00	0.06	20

ProPress Stainless Tubing – Model 4007XL

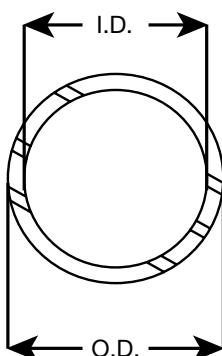


Part No.	Size (in)	O.D. (in)	I.D. (in)	Wall Thickness (in)	Length (ft)
316					
82042	2½	2.63	2.47	0.08	20
82050	3	3.13	2.97	0.08	20
82055	4	4.13	3.97	0.08	20


ProPress 316 ECO Tubing – Models 4008 / 4008XL

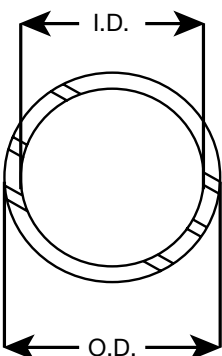


Part No.	Size (in)	O.D. (in)	I.D. (in)	Wall Thickness (in)	Length (ft)
316					
386333	½	0.63	0.55	0.04	20
386343	¾	0.88	0.78	0.05	20
386353	1	1.13	1.03	0.05	20
386363	1¼	1.38	1.26	0.06	20
386373	1½	1.63	1.51	0.06	20
386383	2	2.13	2.01	0.06	20
386473	2½	2.63	2.47	0.08	20
386483	3	3.13	2.97	0.08	20
386493	4	4.13	3.97	0.08	20

ProPress Stainless 90° Elbow P x P – Model 4016


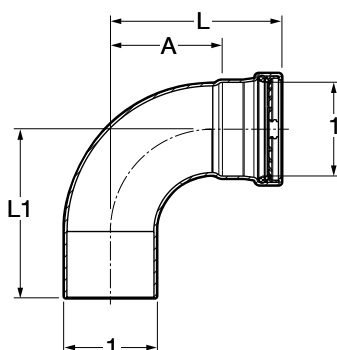
Part No.	Size (in)	A (in)		L (in)	
		Dec	Frac	Dec	Frac
80400	1/2	1.12	1 1/8	1.87	1 7/8
80405	3/4	1.73	1 3/4	2.64	2 5/8
80410	1	1.87	1 7/8	2.78	2 3/4
80415	1 1/4	1.65	1 5/8	2.69	2 11/16
80420	1 1/2	1.98	2	3.41	3 7/16
80425	2	2.55	2 9/16	4.14	4 1/8

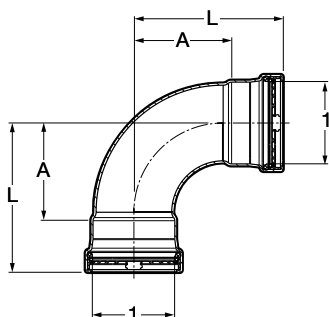ProPress Stainless 90° Elbow P x P – Model 4016XL


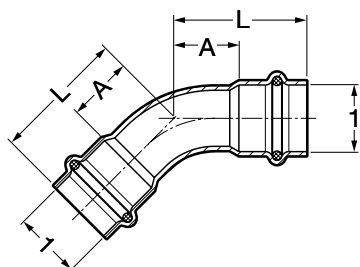
Part No.	Size (in)	A (in)		L (in)	
		Dec	Frac	Dec	Frac
80430	2 1/2 x 2 1/2	3.19	3 3/16	4.88	4 7/8
80435	3 x 3	3.76	3 3/4	5.73	5 3/4
80440	4 x 4	4.86	4 7/8	7.22	7 1/4

ProPress Stainless 90° Elbow FTG x P – Model 4016.1



Part No.	Size (in)	A (in)		L (in)		L1 (in)	
		Dec	Frac	Dec	Frac	Dec	Frac
80490	1/2	1.12	1 1/8	1.87	1 7/8	1.99	2
80495	3/4	1.45	1 7/16	2.35	2 3/8	3.03	3
80500	1	1.87	1 7/8	2.78	2 3/4	3.27	3 1/4
80505	1 1/4	1.65	1 5/8	2.69	2 11/16	2.76	2 3/4
80510	1 1/2	1.98	2	3.41	3 7/16	3.48	3 1/2
80515	2	2.55	2 9/16	4.14	4 1/8	4.20	4 3/16

ProPress Stainless 90° Street Elbow P x FTG – Model 4016.1XL


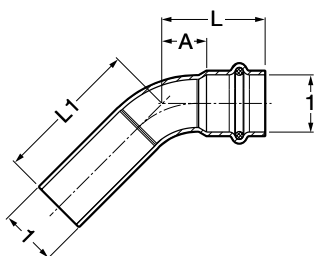
Part No.	Size (in)	A (in)		L (in)		L1 (in)	
		Dec	Frac	Dec	Frac	Dec	Frac
80520	2 1/2 x 2 1/2	3.19	3 3/16	4.88	4 7/8	4.80	4 13/16
80525	3 x 3	3.76	3 3/4	5.73	5 3/4	5.63	5 5/8
80530	4 x 4	4.86	4 7/8	7.22	7 1/4	7.13	7 1/8

ProPress Stainless 45° Elbow P x P – Model 4026


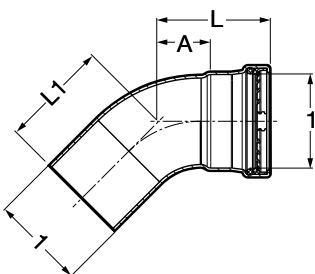
Part No.	Size (in)	A (in)		L (in)	
		Dec	Frac	Dec	Frac
80445	1/2	0.57	9/16	1.32	1 5/16
80450	3/4	0.87	7/8	1.77	1 3/4
80455	1	0.89	7/8	1.79	1 13/16
80460	1 1/4	0.69	1 1/16	1.72	1 3/4
80465	1 1/2	0.82	1 3/16	2.25	2 1/4
80470	2	1.06	1 1/16	2.64	2 5/8

ProPress Stainless 45° Elbow P x P – Model 4026XL


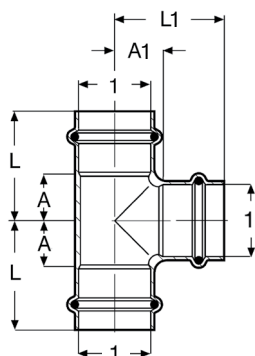
Part No.	Size (in)	A (in)		L (in)	
		Dec	Frac	Dec	Frac
80475	2 1/2 x 2 1/2	1.48	1 1/2	3.18	3 3/16
80480	3 x 3	1.73	1 3/4	3.70	3 11/16
80485	4 x 4	2.19	2 3/16	4.55	4 9/16

ProPress Stainless 45° Elbow FTG x P – Model 4026.1


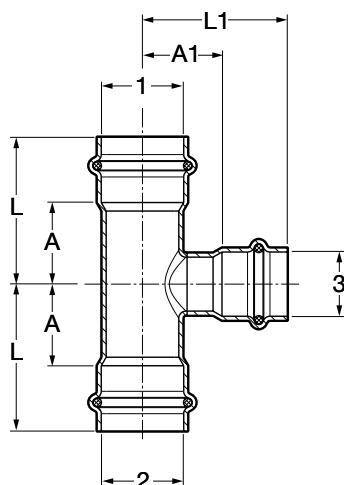
Part No.	Size (in)	A (in)		L (in)		L1 (in)	
		Dec	Frac	Dec	Frac	Dec	Frac
80535	1/2	0.57	9/16	1.32	1 5/16	1.46	1 7/16
80540	3/4	0.69	1 1/16	1.59	1 9/16	2.27	2 1/4
80545	1	0.89	7/8	1.79	1 13/16	2.28	2 1/4
80550	1 1/4	0.69	1 1/16	1.72	1 3/4	1.79	1 13/16
80555	1 1/2	0.82	1 3/16	2.25	2 1/4	2.32	2 5/16
80560	2	1.06	1 1/16	2.64	2 5/8	2.71	2 11/16

ProPress Stainless 45° Street Elbow P x FTG – Model 4026.1XL


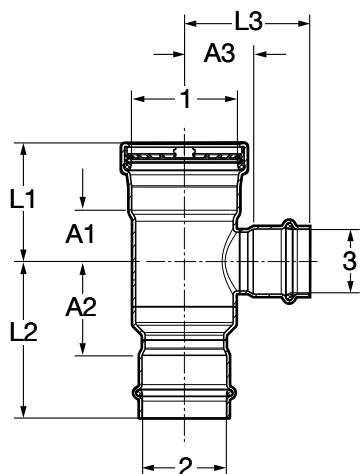
Part No.	Size (in)	A (in)		L (in)		L1 (in)	
		Dec	Frac	Dec	Frac	Dec	Frac
80565	2 1/2 x 2 1/2	1.48	1 1/2	3.18	3 3/16	3.10	3 1/8
80570	3 x 3	1.73	1 3/4	3.70	3 11/16	3.60	3 5/8
80575	4 x 4	2.19	2 3/16	4.55	4 7/16	4.45	4 7/16

ProPress Stainless Tee P x P x P – Model 4018


Part No.	Size (in)		A (in)		A1 (in)		L (in)		L1 (in)	
	316	1	Dec	Frac	Dec	Frac	Dec	Frac	Dec	Frac
80580		1/2	0.75	3/4	0.87	7/8	1.50	1 1/2	1.61	1 5/8
80585		3/4	0.96	15/16	0.96	15/16	1.86	1 7/8	1.86	1 7/8
80590		1	1.13	1 1/8	1.18	1 3/16	2.04	2 1/16	2.09	2 1/16
80595		1 1/4	1.04	1 1/16	1.05	1 1/16	2.08	2 1/16	2.07	2 1/16
80600		1 1/2	1.26	1 1/4	1.22	1 1/4	2.69	2 11/16	2.65	2 5/8
80605		2	1.54	1 9/16	1.53	1 1/2	3.12	3 1/8	3.11	3 1/8


ProPress Stainless Tee P x P x P – Model 4018


Part No.	Size (in)			A (in)		A1 (in)		L (in)		L1 (in)		
	316	1	2	3	Dec	Frac	Dec	Frac	Dec	Frac	Dec	Frac
80630		¾ x ¾ x ½			0.96	15⁄16	0.98	1	1.86	1⅞	1.73	1¾
80640		1 x 1 x ½			1.13	1⅛	1.13	1⅛	2.04	2⅛	1.88	1⅞
80650		1 x 1 x ¾			1.13	1⅛	1.10	1⅛	2.04	2⅛	2.01	2
80660		1¼ x 1¼ x ½			0.75	¾	1.28	1¼	1.78	1¾	2.03	2
80670		1¼ x 1¼ x ¾			0.83	13⁄16	1.25	1¼	1.86	1⅞	2.16	23⁄16
80680		1¼ x 1¼ x 1			1.04	1⅛	1.33	15⁄16	2.08	2⅛	2.24	2¼
80690		1½ x 1½ x ½			1.26	1¼	1.39	1⅜	2.69	211⁄16	2.14	2⅞
80700		1½ x 1½ x ¾			1.26	1¼	1.37	1⅜	2.69	211⁄16	2.27	2¼
80710		1½ x 1½ x 1			1.26	1¼	1.44	17⁄16	2.69	211⁄16	2.35	2⅜
80720		2 x 2 x ½			0.71	1⅛	1.65	1⅝	2.30	25⁄16	2.40	2⅜
80730		2 x 2 x ¾			0.71	1⅛	1.63	1⅝	2.30	25⁄16	2.53	2½
80740		2 x 2 x 1			0.83	13⁄16	1.70	111⁄16	2.41	27⁄16	2.61	2⅝
80750		2 x 2 x 1½			1.15	1⅛	1.49	1½	2.73	2¾	2.91	215⁄16

ProPress Stainless Tee P x P x P – Model 4018XL


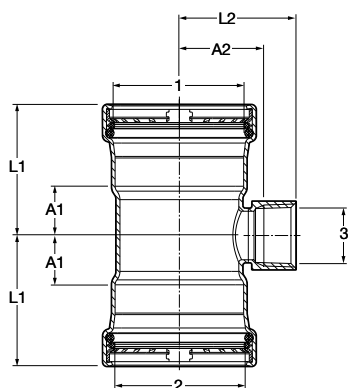
Part No.	Size (in)			A1 (in)		A2 (in)		A3 (in)		L1 (in)		L2 (in)		L3 (in)	
316	1	2	3	Dec	Frac	Dec	Frac	Dec	Frac	Dec	Frac	Dec	Frac	Dec	Frac
80753	2½ x 2 x 1½			1.30	1⅝	2.37	2⅜	1.74	1¾	2.99	3	3.96	3⅞	3.17	3⅜
80752	2½ x 2 x 2			1.54	1⅞	2.69	2⅞	1.78	1¾	3.23	3¼	4.27	4¼	3.37	3⅝
80751	2½ x 2½ x 1½			1.30	1⅝	1.30	1⅝	1.74	1¾	2.99	3	2.99	3	3.17	3⅜
80760	2½ x 2½ x 2			1.54	1⅞	1.54	1⅞	1.78	1¾	3.23	3¼	3.23	3¼	3.37	3⅝
80610	2½ x 2½ x 2½			1.83	1⅞	1.83	1⅞	1.87	1⅞	3.52	3½	3.52	3½	3.56	3⅞
80782	3 x 3 x 1¼			1.24	1¼	1.24	1¼	1.96	1⅞	3.21	3⅞	3.21	3⅞	2.99	3
80781	3 x 3 x 1½			1.32	1⅞	1.32	1⅞	2.00	2	3.29	3⅞	3.29	3⅞	3.43	3⅞
80770	3 x 3 x 2			1.56	1⅞	1.56	1⅞	2.04	2⅞	3.52	3½	3.52	3½	3.62	3⅝
80780	3 x 3 x 2½			1.85	1⅞	1.85	1⅞	2.13	2⅞	3.82	3⅞	3.82	3⅞	3.82	3⅞
80615	3 x 3 x 3			2.07	2⅞	2.07	2⅞	2.15	2⅞	4.04	4⅞	4.04	4⅞	4.11	4⅞
80791	4 x 4 x 1½			1.36	1⅞	1.36	1⅞	2.51	2½	3.72	3¾	3.72	3¾	3.94	3⅞
80790	4 x 4 x 2			1.59	1⅞	1.59	1⅞	2.55	2⅞	3.96	3⅞	3.96	3⅞	4.13	4⅞
80800	4 x 4 x 2½			1.89	1⅞	1.89	1⅞	2.64	2⅞	4.25	4¼	4.25	4¼	4.33	4⅞
80810	4 x 4 x 3			2.11	2⅞	2.11	2⅞	2.66	2⅞	4.47	4½	4.47	4½	4.63	4⅞
80620	4 x 4 x 4			2.60	2⅞	2.60	2⅞	2.66	2⅞	4.96	4⅞	4.96	4⅞	5.02	5

ProPress Stainless Reducing Tee P x P x FPT – Model 4017.2

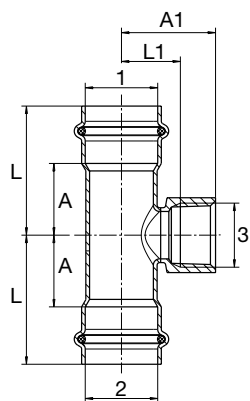


Part No.	Size (in)			A (in)		A1 (in)		L (in)		L1 (in)		
	316	1	2	3	Dec	Frac	Dec	Frac	Dec	Frac	Dec	Frac
80820		¾ x ¾ x ½	FPT		0.96	15/16	1.26	1¼	1.86	1⅞	0.76	¾
80830		¾ x ¾ x ¾	FPT		0.96	15/16	1.34	15/16	1.86	1⅞	0.78	¾
80840		1 x 1 x ½	FPT		1.13	1⅛	1.41	17/16	2.04	21/16	0.87	7/8
80850		1 x 1 x ¾	FPT		1.13	1⅛	1.48	1½	2.04	21/16	0.93	15/16
80860		1¼ x 1¼ x ½	FPT		0.75	¾	1.56	19/16	1.78	1¾	1.02	1
80870		1¼ x 1¼ x ¾	FPT		0.83	13/16	1.63	15/8	1.86	1⅞	1.08	11/16
80880		1¼ x 1¼ x 1	FPT		1.04	11/16	1.75	1¾	2.08	21/16	1.09	11/16
80890		1½ x 1½ x ½	FPT		1.26	1¼	1.67	111/16	2.69	211/16	1.13	1⅛
80900		1½ x 1½ x ¾	FPT		1.26	1¼	1.75	1¾	2.69	211/16	1.19	13/16
80910		1½ x 1½ x 1	FPT		1.26	1¼	1.87	1⅞	2.69	211/16	1.20	13/16
80920		2 x 2 x ½	FPT		0.71	11/16	1.93	115/16	2.30	25/16	1.39	1⅜
80930		2 x 2 x ¾	FPT		0.71	11/16	2.01	2	2.30	25/16	1.45	17/16
80940		2 x 2 x 1	FPT		0.83	13/16	2.13	2⅛	2.41	27/16	1.50	1½

ProPress Stainless Reducing Tee P x P x FPT – Model 4017.2XL




Part No.	Size (in)			A1 (in)		A2 (in)		L1 (in)		L2 (in)		
	316	1	2	3	Dec	Frac	Dec	Frac	Dec	Frac	Dec	Frac
80950		2½ x 2½ x ¾			1.02	1	1.73	1¾	2.72	2¾	2.28	2¼
80960		2½ x 2½ x 1			1.02	1	1.74	1¾	2.72	2¾	2.38	2⅜
80970		3 x 3 x ¾			1.04	1⅙	1.98	2	3.01	3	2.54	2⅞
80980		3 x 3 x 1			1.04	1⅙	1.98	2	3.01	3	2.64	2⅝
80990		4 x 4 x ¾			1.08	1⅙	2.50	2½	3.44	3⅞	3.05	3⅙
81000		4 x 4 x 1			1.08	1⅙	2.49	2½	3.44	3⅞	3.15	3⅜


ProPress Stainless Cross P x P x FPT x FPT – Model 4044.2XL

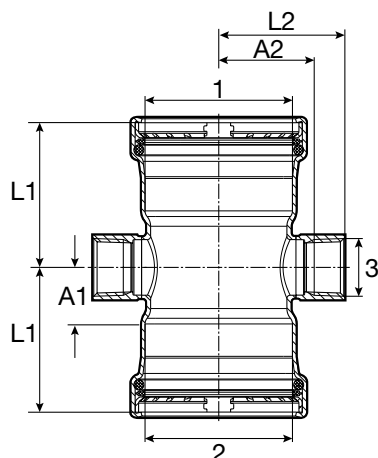


Part No.	Size (in)			A1 (in)		A2 (in)		L1 (in)		L2 (in)		
	316	1	2	3	Dec	Frac	Dec	Frac	Dec	Frac	Dec	Frac
80067	2½	x 2½	x ¾		1.02	1	1.73	1¾	2.62	2⅝	2.28	2¼
80069	3	x 3	x ¾		1.04	1⅛	1.98	2	3.01	3	2.54	2⅞
80068	4	x 4	x ¾		1.08	1⅛	2.50	2½	3.44	3⅞	3.05	3⅛

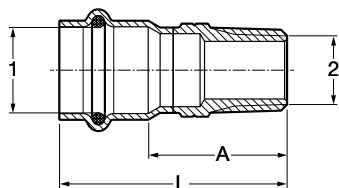ProPress Stainless Adapter P x MPT – Model 4011


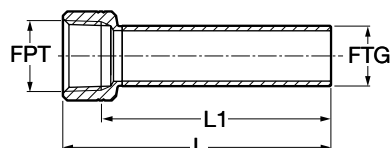
Part No. 316	Size (in)		A (in)		L (in)	
	1	2	Dec	Frac	Dec	Frac
80010	½ x ½ MPT		1.37	1⅜	2.11	2⅛
80015	½ x ¾ MPT		1.44	1⅞	2.19	2⅜
80020	¾ x ½ MPT		1.42	1⅞	2.32	2⅝
80025	¾ x ¾ MPT		1.46	1⅞	2.36	2⅜
80030	¾ x 1 MPT		1.71	1⅞	2.62	2⅝
80035	1 x ¾ MPT		1.47	1½	2.37	2⅜
80040	1 x 1 MPT		1.74	1¾	2.65	2⅝
80045	1¼ x 1¼ MPT		1.89	1⅞	2.92	2⅝
80050	1½ x 1½ MPT		1.94	1⅝	3.37	3⅜
80055	2 x 2 MPT		2.10	2⅞	3.68	3⅝

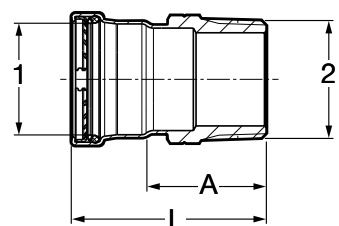ProPress Stainless Adapter P x MPT – Model 4011XL


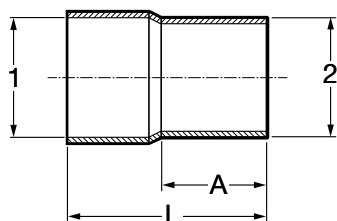
Part No. 316	Size (in)		A (in)		L (in)	
	1	2	Dec	Frac	Dec	Frac
80060	2½ x 2½ MPT		2.99	3	4.69	4⅞
80065	3 x 3 MPT		3.09	3⅞	5.06	5⅞
80070	4 x 4 MPT		3.13	3⅞	5.49	5½

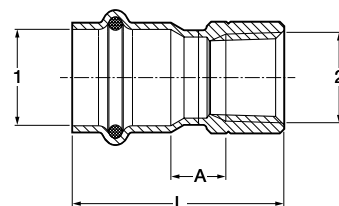ProPress Stainless Adapter P x FPT – Model 4012


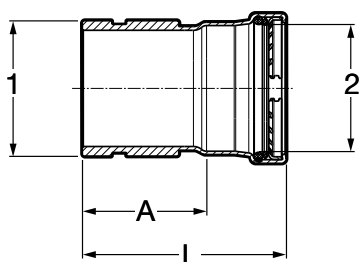
Part No. 316	Size (in)		A (in)		L (in)	
	1	2	Dec	Frac	Dec	Frac
80080	½ x ½ FPT		0.54	⅞	1.82	1⅞
80085	¾ x ½ FPT		0.51	½	1.95	1⅝
80090	¾ x ¾ FPT		0.57	⅞	2.03	2
80092	1 x ½ FPT		0.62	⅝	2.06	2⅞
80095	1 x ¾ FPT		0.62	⅝	2.08	2⅞
80100	1 x 1 FPT		0.61	⅝	2.18	2⅜
80105	1¼ x 1¼ FPT		0.62	⅝	2.33	2⅝
80110	1½ x 1¼ FPT		0.69	1⅞	2.80	2⅝
80115	1½ x 1½ FPT		0.69	1⅞	2.80	2⅝
80075	2 x 1 FPT		0.75	¾	2.99	3
80120	2 x 1½ FPT		0.73	¾	2.99	3
80125	2 x 2 FPT		0.71	1⅞	2.99	3

ProPress 316 Instrument Adapter – Model 4012.5


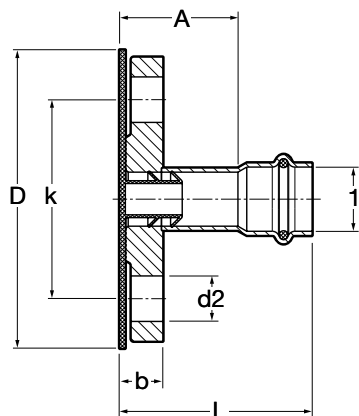
Part No. 316	Size (in)		L (in)		L1 (in)	
	FPT x FTG		Dec	Frac	Dec	Frac
80126	½ x ½		4.06	4⅞	3.52	3½
80127	¾ x ¾		3.94	3⅝	3.38	3⅜

ProPress Stainless Adapter BW (IPS) x FTG – Model 4013.1XL


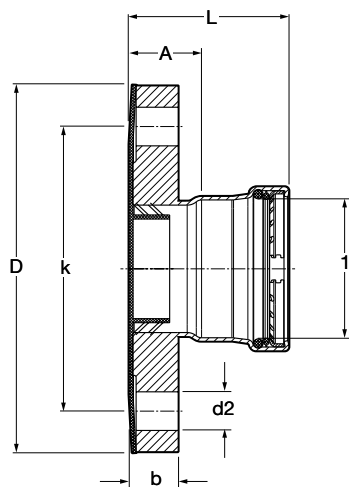
Part No.	Size (in)		A (in)		L (in)		
	316	1 (IPS)	2 (CTS)	Dec	Frac	Dec	Frac
80081		2½ ID	2½ OD	2.32	2⅝	4.37	4⅜
80082		3 ID	3 OD	2.60	2⅝	4.57	4⅞
80083		4 ID	4 OD	2.99	3	5.16	5⅜

ProPress Stainless Adapter Groove x P – Model 4013.2XL


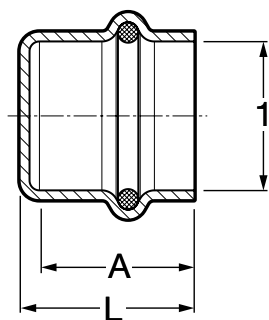
Part No.	Size (in)		A (in)		L (in)	
	316	1 G (IPS) 2	Dec	Frac	Dec	Frac
80064	2½	2½	2.64	2⅝	4.33	4⅝
80061	3	3	2.66	2⅞	4.63	4⅝
80063	4	4	2.66	2⅞	5.02	5

ProPress Stainless Adapter Flange P x Flange – Model 4059


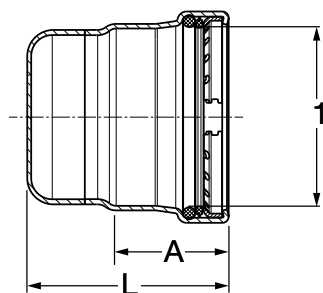
Part No.	Size (in)	b (in)		A (in)		L (in)		k (in)		D (in)		d2 (in)	
		Dec	Frac	Dec	Frac	Dec	Frac	Dec	Frac	Dec	Frac	Dec	Frac
81035	½	0.46	7/ ₁₆	1.72	1¾	2.46	27/ ₁₆	2.36	2¾	3.54	39/ ₁₆	0.63	5/ ₈
81040	¾	0.52	1/2	1.66	1 ¹¹ / ₁₆	2.57	29/ ₁₆	2.76	2¾	3.94	3 ¹⁵ / ₁₆	0.63	5/ ₈
81045	1	0.58	9/ ₁₆	1.60	1 ⁵ / ₈	2.51	2½	3.11	3¾	4.33	45/ ₁₆	0.63	5/ ₈
81050	1¼	0.64	5/ ₈	1.66	1 ¹¹ / ₁₆	2.69	2 ¹¹ / ₁₆	3.50	3½	4.53	4½	0.63	5/ ₈
81055	1½	0.70	1 ¹ / ₁₆	1.41	1 ⁷ / ₁₆	2.83	2 ¹³ / ₁₆	3.86	3 ⁷ / ₈	4.92	4 ¹⁵ / ₁₆	0.63	5/ ₈
81060	2	0.77	¾	2.30	2 ⁵ / ₁₆	3.86	3 ⁷ / ₈	4.76	4¾	5.91	5 ¹⁵ / ₁₆	0.75	¾

ProPress Stainless Adapter Flange P x Flange – Model 4059XL


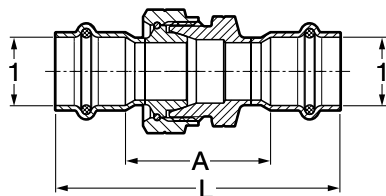
Part No.	Size (in)	b (in)		A (in)		L (in)		k (in)		D (in)		d2 (in)	
		Dec	Frac	Dec	Frac	Dec	Frac	Dec	Frac	Dec	Frac	Dec	Frac
81065	2½	0.89	7/8	1.35	13/8	3.04	31/16	5.51	5½	7.09	71/16	0.75	3/4
81070	3	0.96	15/16	1.39	13/8	3.40	33/8	5.98	6	7.48	7½	0.75	3/4
81075	4	0.96	15/16	1.40	13/8	3.77	3¾	7.52	7½	9.06	91/16	0.75	3/4

ProPress Stainless Cap P – Model 4056


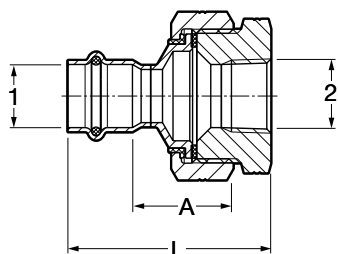
Part No.	Size (in)	A (in)		L (in)	
		Dec	Frac	Dec	Frac
80355	½	0.70	11/16	0.82	13/16
80360	¾	0.93	15/16	1.04	11/16
80365	1	0.94	15/16	1.06	11/16
80370	1¼	1.04	11/16	1.20	13/16
80375	1½	1.44	17/16	1.59	19/16
80380	2	1.59	19/16	1.74	1¾

ProPress Stainless Cap P – Model 4056.1XL


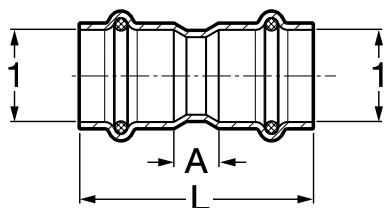
Part No.	Size (in)	A (in)		L (in)	
		Dec	Frac	Dec	Frac
80385	2½	1.69	111/16	3.01	3
80390	3	1.97	2	3.33	35/16
80395	4	2.36	23/8	3.72	3¾

ProPress Stainless Union P x P – Model 4060


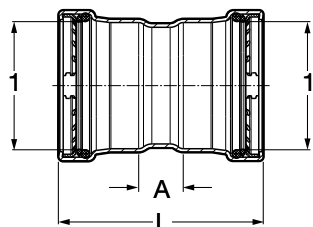
Part No.	Size (in)	A (in)		L (in)	
		Dec	Frac	Dec	Frac
81005	1/2	1.87	17/8	3.37	33/8
81010	3/4	1.89	17/8	3.70	311/16
81015	1	2.25	21/4	4.06	41/16
81020	1 1/4	2.25	21/4	4.31	45/16
81025	1 1/2	2.68	211/16	5.53	51/2
81030	2	2.95	215/16	6.12	61/8

ProPress 316 Dielectric Union P x FPT – Model 4067


Part No.	Size (in)		A (in)		L (in)	
	1	2	Dec	Frac	Dec	Frac
80071	1/2 x 1/2	FPT	1.28	1 1/4	2.57	29/16
80078	3/4 x 3/4	FPT	1.39	1 3/8	2.85	27/8
80073	1 x 1	FPT	1.25	1 1/4	2.81	213/16
80074	1 1/4 x 1 1/4	FPT	1.33	1 5/16	3.04	31/16
80076	1 1/2 x 1 1/2	FPT	1.54	1 9/16	3.64	35/8
80077	2 x 2	FPT	1.72	1 3/4	4.00	4


ProPress Stainless Coupling with Stop P x P – Model 4015


Part No.	Size (in)	A (in)		L (in)	
		Dec	Frac	Dec	Frac
80265	1/2	0.35	3/8	1.85	17/8
80270	3/4	0.43	7/16	2.24	21/4
80275	1	0.39	3/8	2.20	23/16
80280	1 1/4	0.47	1/2	2.54	29/16
80285	1 1/2	0.36	3/8	3.21	33/16
80290	2	0.47	1/2	3.64	35/8

ProPress Stainless Coupling with Stop P x P – Model 4015XL


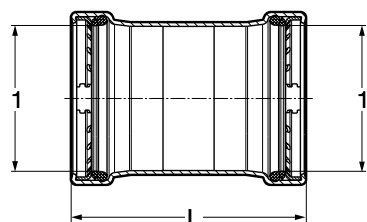
Part No.	Size (in)		A (in)		L (in)	
	1	1	Dec	Frac	Dec	Frac
80295	2 1/2 x 2 1/2		0.95	15/16	4.33	45/16
80300	3 x 3		0.98	1	4.92	415/16
80305	4 x 4		1.06	1 1/16	5.79	513/16

ProPress Stainless Coupling No Stop P x P – Model 4015.5

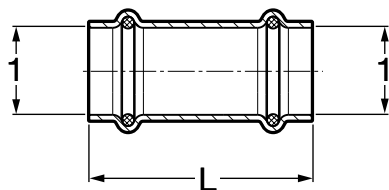


Part No. 316	Size (in)		L (in)	
	1	Dec	Frac	
80310	1/2	1.87	1 7/8	
80315	3/4	2.27	2 1/4	
80320	1	2.19	2 3/16	
80325	1 1/4	2.54	2 9/16	
80330	1 1/2	3.27	3 1/4	
80335	2	3.66	3 11/16	

ProPress Stainless Coupling No Stop P x P – Model 4015.5XL




Part No. 316	Size (in)		L (in)	
	1	1	Dec	Frac
80340	2 1/2	x 2 1/2	4.33	4 5/16
80345	3	x 3	4.92	4 15/16
80350	4	x 4	5.79	5 13/16


ProPress Stainless Reducer FTG x P – Model 4015.1

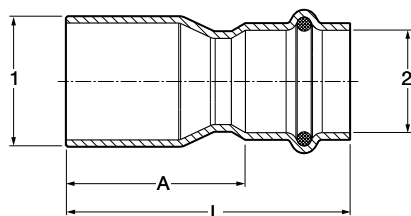


Part No. 316	Size (in)		A (in)		L (in)	
	1	2	Dec	Frac	Dec	Frac
80160	3/4	x 1/2	1.54	1 9/16	2.28	2 1/4
80165	1	x 1/2	1.84	1 13/16	2.59	2 9/16
80170	1	x 3/4	1.56	1 9/16	2.46	2 7/16
80175	1 1/4	x 1/2	2.25	2 1/4	3.00	3
80180	1 1/4	x 3/4	1.93	1 15/16	2.83	2 13/16
80185	1 1/4	x 1	1.81	1 13/16	2.72	2 3/4
80190	1 1/2	x 1/2	3.03	3	3.78	3 3/4
80195	1 1/2	x 3/4	2.64	2 5/8	3.54	3 9/16
80200	1 1/2	x 1	2.50	2 1/2	3.41	3 7/16
80205	1 1/2	x 1 1/4	2.26	2 1/4	3.29	3 5/16
80210	2	x 1/2	3.75	3 3/4	4.50	4 1/2
80215	2	x 3/4	3.48	3 1/2	4.39	4 3/8
80220	2	x 1	3.08	3 1/16	3.99	4
80225	2	x 1 1/4	2.94	2 15/16	3.97	4
80230	2	x 1 1/2	2.59	2 9/16	4.02	4

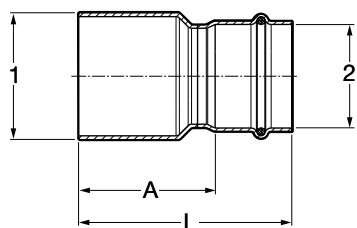ProPress Stainless Reducer FTG x P – Model 4015.1XL


Part No.	Size (in)		A (in)		L (in)	
	1	2	Dec	Frac	Dec	Frac
80235	2½ x 2		2.85	27⁄8	4.43	47⁄16
80240	3 x 2		3.38	33⁄8	4.96	415⁄16
80245	3 x 2½		3.21	33⁄16	4.90	47⁄8
80250	4 x 2		4.26	4¼	5.85	57⁄8
80255	4 x 2½		4.09	41⁄16	5.79	513⁄16
80260	4 x 3		3.88	37⁄8	5.85	57⁄8

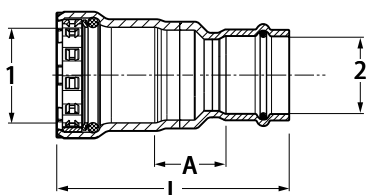ProPress to MegaPress Transition Coupling, Stainless Steel, P x P – Model 5113


Part No.	Size (in)		A (in)		L (in)	
	1 (IPS)	2 (CTS)	Dec	Frac	Dec	Frac
90465	½ x ½		1.07	1¼	2.93	215⁄16
90470	¾ x ¾		1.07	1¼	3.17	33⁄16
90475	1 x 1		1.11	1⅝	3.40	33⁄8
90890	1¼ x 1¼		1.11	1⅝	4.00	4
90485	1½ x 1½		1.21	13⁄16	4.55	49⁄16
90490	2 x 2		1.23	1¼	4.82	413⁄16

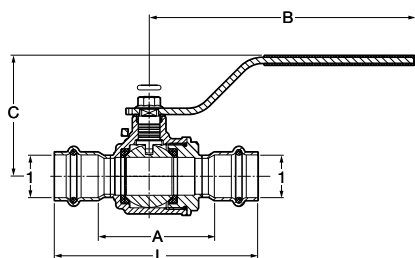ProPress 316 Ball Valve P x P – Model 4070


Part No.	Size (in)	A (in)		L (in)		B (in)		C (in)	
		Dec	Frac	Dec	Frac	Dec	Frac	Dec	Frac
81080	½	2.06	21⁄16	3.56	39⁄16	5.55	59⁄16	2.44	27⁄16
81085	¾	2.42	27⁄16	4.23	4¼	5.55	59⁄16	2.52	21⁄2
81090	1	2.76	2¾	4.59	49⁄16	5.55	59⁄16	2.68	211⁄16
81095	1¼	3.17	33⁄16	5.23	5¼	6.10	61⁄8	3.09	31⁄16
81100	1½	3.65	35⁄8	6.50	6½	6.10	61⁄8	3.34	35⁄16
81105	2	4.15	41⁄8	7.32	75⁄16	6.10	61⁄8	3.66	311⁄16

6 Limited Warranty – Viega Metal Systems

Subject to the conditions and limitations in this Limited Warranty (“Warranty”), Viega LLC (“Viega”) warrants to end users, installers, and distributors in the United States and Canada that the following products (“Viega Products”) will be free of failure caused by a manufacturing defect from the date of installation for the time periods specified in the table included in this Warranty.

This Warranty will be valid only in the event the following conditions have been met: The Viega Products have been properly installed (1) under normal conditions of use; (2) under applications approved by Viega; (3) under Viega-specified system operating conditions; (4) using tools compatible with Viega systems; and (5) in alignment with Viega’s listings.

Further, you have a right to a remedy under this Warranty only if the Viega Product failure resulted from a manufacturing defect in the Viega Product and if the failure occurred during the applicable warranty period. You do not have a remedy under this Warranty if the failure was caused by (1) components other than those manufactured and/or sold by Viega; (2) failure to design, install, inspect, test, or maintain the Viega Product in accordance with Viega’s installation and product instructions in effect at the time of installation; (3) use of Viega Products under non-recommended system operating conditions (e.g., water pressures, temperatures, or other external chemical or physical conditions); (4) improper handling or protection of the Viega Product prior to, during, or after installation (e.g., inadequate freeze protection or exposure to environmental conditions not recommended for the application); or (5) acts of nature, including, without limitation, earthquakes, fire, or weather damage.

In the event of a failure of a Viega Product covered by this Warranty, it is the duty and responsibility of the end user to take appropriate measures to mitigate all potential damage, including making timely repairs to the system in which the Viega Product has been installed. The part or parts which you claim failed must be kept and returned to Viega for testing. Viega may be contacted at the phone number or mailing address below. All warranty claims must be made within 30 calendar days after the failure has (or

should reasonably have) been discovered. You should be prepared to ship, at your expense, the Viega Product which you claim failed due to a manufacturing defect, with documentation of the installation date and the amount spent on any repair or replacement if performed by you. Within a reasonable time after receiving the Viega Product, Viega will investigate the cause of the failure, which includes the right to inspect the Viega Product at a Viega location and reasonable access to the site of any alleged damage. Viega will notify you in writing of the results of its review.

In the event Viega determines that the failure was the result of a manufacturing defect in the Viega Product covered by this Warranty and all conditions of this Warranty have been met, your **SOLE AND EXCLUSIVE REMEDY** under this Warranty shall be the reimbursement for the reasonable costs of repair or replacement of the Viega Product itself. **VIEGA SHALL NOT BE LIABLE FOR ANY CONSEQUENTIAL OR OTHER SIMILAR DAMAGES (E.G., ECONOMIC LOSS, WATER OR PROPERTY DAMAGE, OR MOLD REMEDIATION) UNDER ANY LEGAL THEORY AND WHETHER ASSERTED BY DIRECT ACTION, FOR CONTRIBUTION, INDEMNITY, OR OTHERWISE.**

THIS WARRANTY IS IN LIEU OF ALL OTHER WARRANTIES, EXPRESS, OR IMPLIED, INCLUDING, WITHOUT LIMITATION, THE IMPLIED WARRANTIES OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE OR ANY STATUTE OF LIMITATIONS RELATING TO SUCH WARRANTIES. Viega will be responsible for remedies only if all conditions of this Warranty have been met. Other than this Warranty, Viega does not authorize any person, company, contractor, or distributor to create any additional warranty, obligation, or liability in connection with the Viega Product.

This Warranty gives you specific legal rights, and you also may have other rights which may vary from state to state. This Warranty shall be interpreted and applied under the law of the state in which the product is installed and is intended as a **COMMERCIAL WARRANTY**.

Continues on next page.

Warranty Period by Product and Application Type		
Viega Product Line	Residential and Commercial	Industrial ¹ and Marine ²
ProPress® copper fittings	50 years	2 years
ProPress 316 fittings and tubing	10 years	
MegaPress® fittings	15 years	
MegaPress FKM fittings		
MegaPress 304 FKM fittings		
MegaPress 316 fittings		
MegaPress 316 FKM fittings		
MegaPressG ³ fittings		
MegaPress CuNi fittings		
All valves	5 years	
¹ Industrial applications are defined as non-residential and non-commercial applications not normally accessible to the general public, including manufacturing, mining, process, or fabrication environments, or applications with components that have been cleaned for oxygen service.		
² Marine applications are defined as mobile structures used to navigate water or stationary structures in water.		
³ MegaPressG products covered by this Warranty must be installed by a licensed contractor in compliance with applicable building, permit, and inspection codes. See product instructions for additional information.		